


CROSSING UNDER SANITARY SEWER

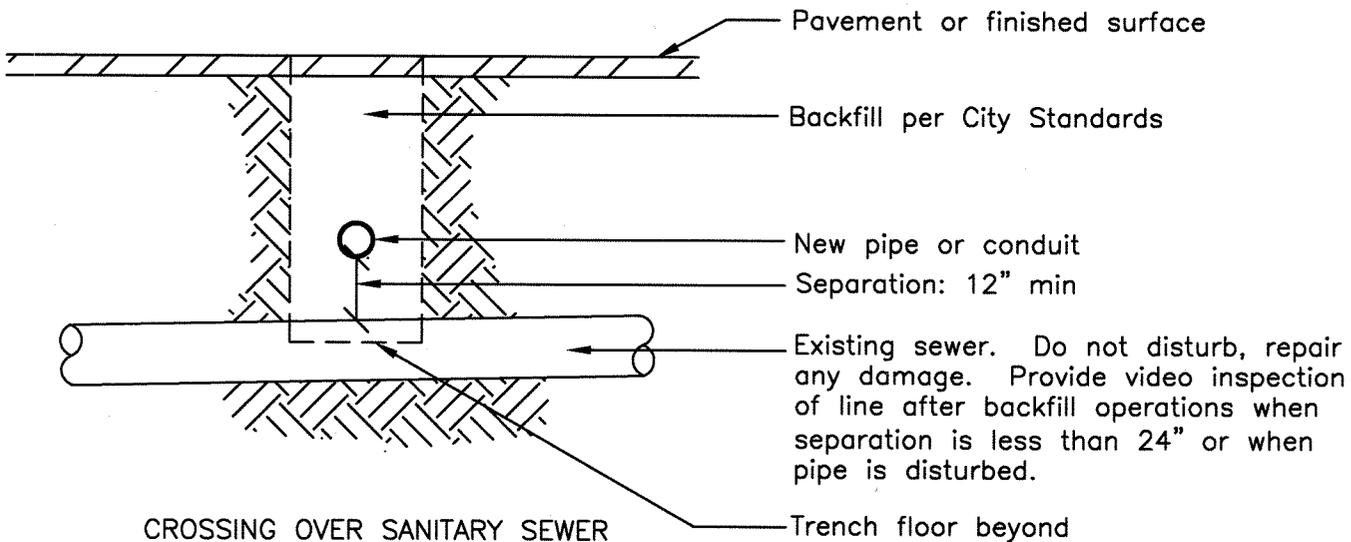

CROSSING OVER SANITARY SEWER

Notes:

1. Solid pipe shall be one continuous length of cast iron soil pipe, ASTM A74. Extend new pipe to next joint or manhole if less than 24" away.
2. Joint on 12" and smaller pipes shall be synthetic rubber coupling with stainless steel compression bands and stainless steel shear ring. (Type D joint). Mechanical compression joint required on pipes larger than 12". City Engineer approval is required for mechanical compression joints, submit cut sheet prior to ordering material.
3. All work shall be done in accordance with the Standard Specifications for Public Works Construction, the "GREENBOOK", the most current edition and all supplements thereto, adopted by the Southern California Chapter of the American Public Works Association and the Special Provisions (Technical Specifications) thereto adopted by the City.
4. This detail applies only to open trench work.

ACAD FILE NO. C3101D304 Rev3.DWG.

CITY OF SAN LEANDRO * STANDARD PLANS

NO.	REVISIONS	DATE	BY	APPROVED									
3	REVISED NOTE 2	1/13/16	NT	 Nick Thorn, City Engineer R.C.E. No. 54659 Expires 12/31/17									
SANITARY SEWER CROSSING													
DRAWN	GF/MLWH/VL	CHECKED	KJ/KRC	DATE	May 2002	SCALE	NONE	SHEET	1 OF 1	DWG. NO.	304	CASE.	3101