


SECTION A-A

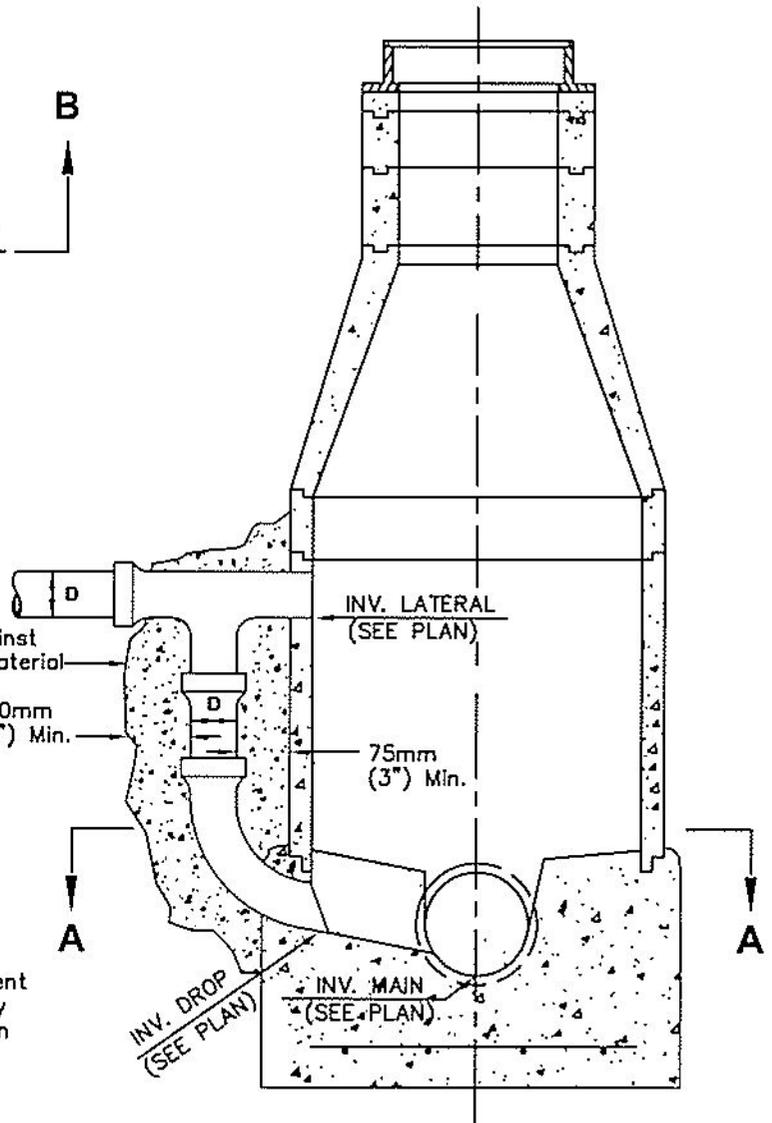

SECTION B-B

NOTES:

1. All work shall be done in accordance with the Standard Specifications for Public Works Construction, the "GREENBOOK", the most current edition and all supplements thereto, adopted by the Southern California Chapter of the American Public Works Association and the Special Provisions (Technical Specifications) thereto adopted by the City.
2. Drop Manhole shall conform to Concrete Manhole Dwg. 214 or 216 Case 3101 in all respects except where specifically shown or noted otherwise on this drawing.
3. Drop Manhole shall be installed only with specific PRIOR approval of the City Engineer.
4. Retrofit of (E) manholes with interior drop of CIP materials w/ SS fasteners shall be installed only with specific PRIOR approval of the City Engineer.


TABLE OF MINIMUM DROPS			
PIPE DIAMETER (D)	150mm (6")	200mm (8")	250mm (10")
MINIMUM DROP (INVERT LATERAL TO INVERT DROP)	375mm (1'-3")	450mm (1'-6")	525mm (1'-9")

ACAD FILE NO. C3101D218.DWG.

CITY OF SAN LEANDRO * STANDARD PLANS

NO.	REVISIONS	DATE

DROP MANHOLE

APPROVED  6/24/02
 Kenneth Joseph, City Engineer R.C.E. No. 64870
 Expires 8/30/03